


Flushing Program – Request for Reduction or Cessation

All flushing programs must begin with a minimum of chlorine residual(s) sampling event one (1) per week and one (1) watermain flushing every two (2) weeks.

Any changes must be approved by the Environmental Services - Compliance & Training before being implemented.

The following flow chart will assist in the determination of flushing program changes. Requests for consideration can be made by email to Newmain@vaughan.ca

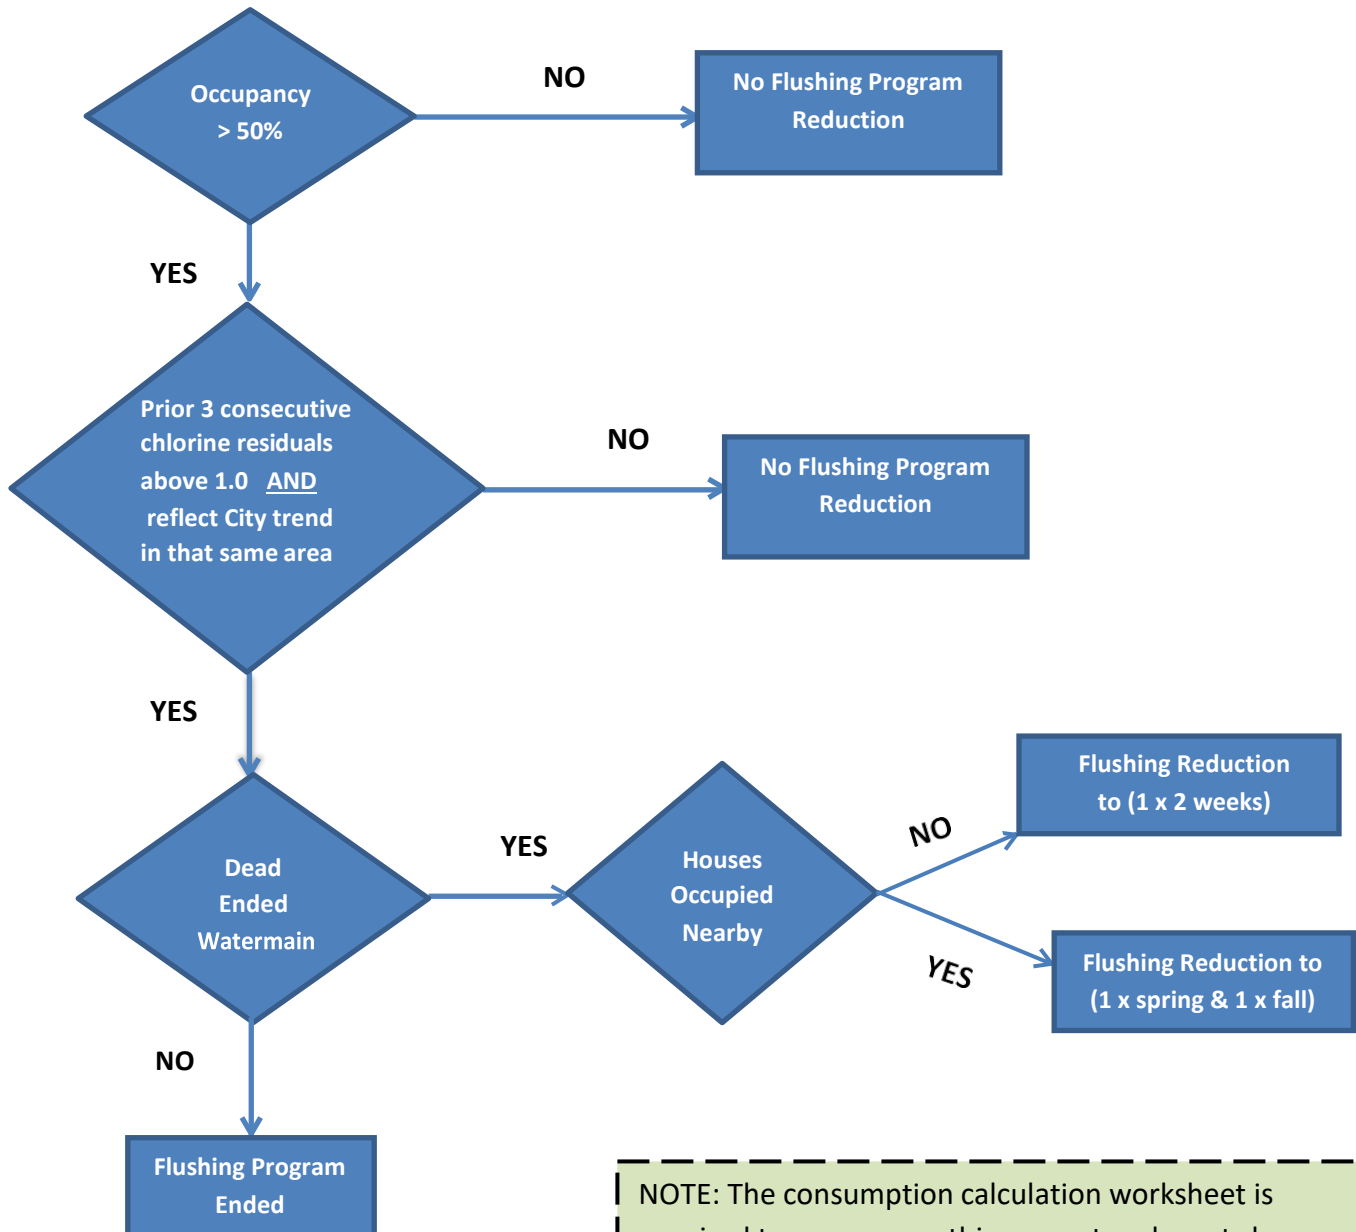

NOTE: The consumption calculation worksheet is required to accompany this request and must show that the watermain can be turned over within 3 days for any flushing program reduction or cessation to be approved.